
WALL REINFORCEMENT MATRIX - CASE A⁽¹⁾

MAX. WALL Height (ft)	BASE DEPTH (ft.)	NO. GRID LAYERS	TOP GRID LENGTH (ft.)*	GEOGRID PLACEMENT h (ft.) above base elevation					* NOTE
ricigite (re)				h1	h2	h3	h4	h5	
4'-0"	0'-8"	2	3'-8"	0'-8"	2'-8"	_	—		LAYER LENGTH MAY DECREASE 6" PER SUCCEEDING LAYER FROM TOP TO BOTTOM.
5'-4"	0'-8"	2	4'-0"	1'-4"	3'-4"		—	—	
6'-0"	0'-8"	2	4'-4"	2'-0"	4'-8"	_	—		
7'-4"	1'-4"	3	5'-0"	1'-4"	3'-8"	5'-8"	—		
8'-0"	1'-4"	4	6'-0"	0'-8"	3'-0"	5'-4"	7'-4"		
10'-0"	1'-4"	5	7'-0"	0'-8"	2'-8"	4'-8"	6'-4"	8'-8"	

(1) CASE A: LEVEL TOP GRADE, NO SURCHARGE, FOR SITE SOILS WITH ANGLE Ø>27° AND SOIL SATURATED UNIT WEIGHT OF LESS THAN 125 PCF.

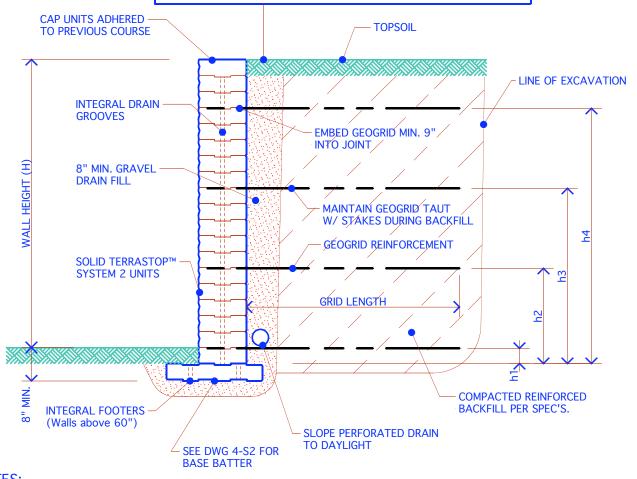

NOTES:

- Sample design for preliminary estimating only, based on 80 mil polyester geogrid with tensile strength of 1600 lb/ft; for polyethelyne grids, adjust design per grid properties.
- 2. Analysis of global stability not included here, and should be part of final design by qualified structural engineer.
- 3. Minimum safety factors to be used for final design should be: 1.5 for tension, 1.5 for external sliding and 2.0 for overturning.
- 4. Final design must consider actual soil type and conditions.
- 5. For taller applications wall batter or setbacks may be required; Detailed analysis of global stability is mandatory.

REINFORCED SECTION - case A

© 2001 Synthesis International Inc. - World Rights Reserved

WALL ANGLE 0° NO SURCHARGE

TERRASTOP™ SYSTEM 2

RAPID BUILDING SYSTEMS P.O. Box 3335 Reston, VA 20195 - USA

SCALE: NONE PROJECT: 99601

DRAWN: PD DESIGN: JP DATE: 6-01

DRAWN: PD DESIGN: JP DATE: 6-01